


Section A - A

NOTES

1. All dimensions in millimetres unless shown otherwise.
2. The minimum culvert diameter should be 450mm unless agreed with an MKCC engineer. Where a culvert is longer than 12m, it shall have a minimum span/height of 1.2m in accordance with CD 529.
3. Box culverts shall be designed in accordance with CD529 for maintenance and screening requirements.
4. Culverts with b or pipes with d greater than 900 must comply with DMRB CG 300.
5. For further information refer to Standard Detail Guidance Note drawing no. MKCC-100-001.

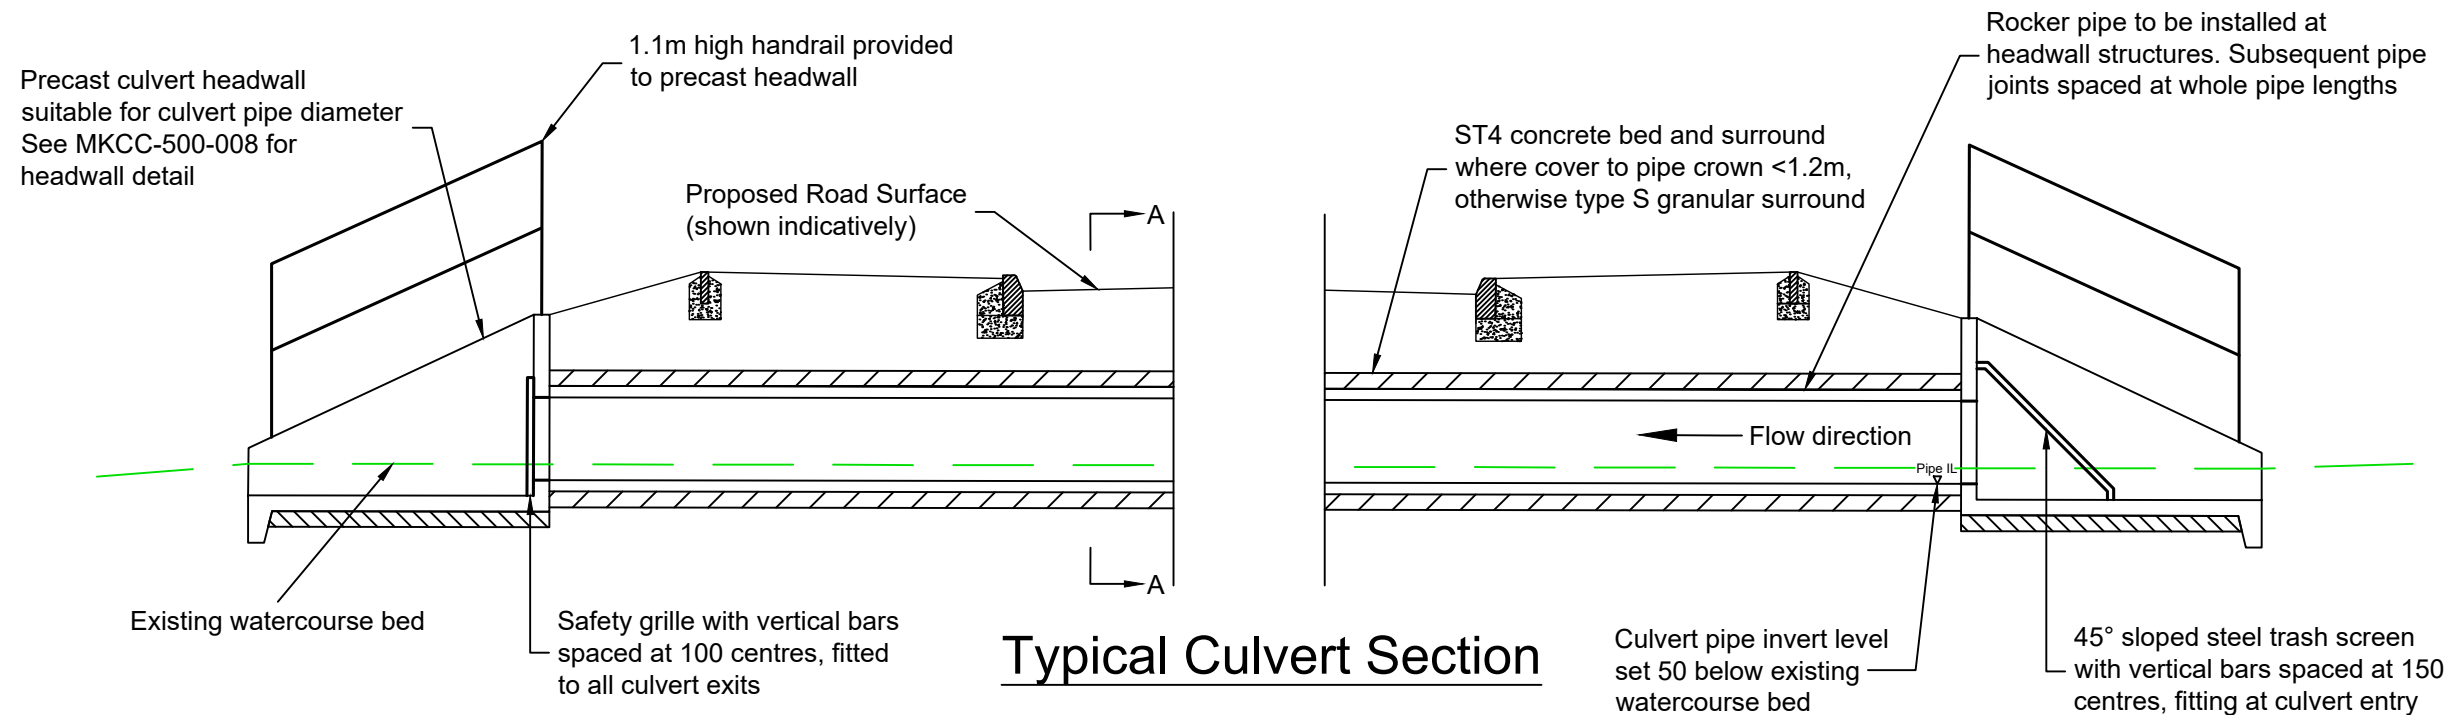

Typical Culvert Section

MK Milton Keynes City Council

Highways and Transportation
Civic Offices
1 Saxon Gate East
Central Milton Keynes
MK9 3EJ

DRAWING TITLE:
Culvert (Drain Type D1)

SCALE:	REV:	DRAWN:	CHECKED:	APPROVED:	REV:	AMENDMENTS:	DRN:	CHCK'D:	APPR'D:	DATE:
NTS	P01	INITIALS: LP	JM	LS						
		DATE: 16/10/2025	17/03/2026	17/03/2026	DRAWING NO: MKCC-500-007					

