


- NOTES**
1. All dimensions are in millimetres unless shown otherwise.
 2. A separation membrane shall be used between the concrete slab and the sub-base. Separation membranes shall be impermeable plastic sheeting 125 microns thick laid flat without creases. Where an overlap of plastic sheets is necessary, this shall be at least 300mm. There shall be no standing water on or under the membrane when the concrete is placed upon it.
 3. For further information refer to Standard Details Guidance Note drawing no. MKCC-100-001.



<p>Highways and Transportation Civic Offices 1 Saxon Gate East Central Milton Keynes MK9 3EJ</p>	DRAWING TITLE:										
	Bus Laybys (1 of 2)										
	SCALE:	REV:	DRAWN:	CHECKED:	APPROVED:	REV:	AMENDMENTS:	DRN:	CHCK'D:	APPR'D:	DATE:
	NTS	P01	PG	JM	LS	DRAWING NO: MKCC-700-003					
		DATE:	17/02/2026	17/03/2026	17/03/2026						00/00/0000

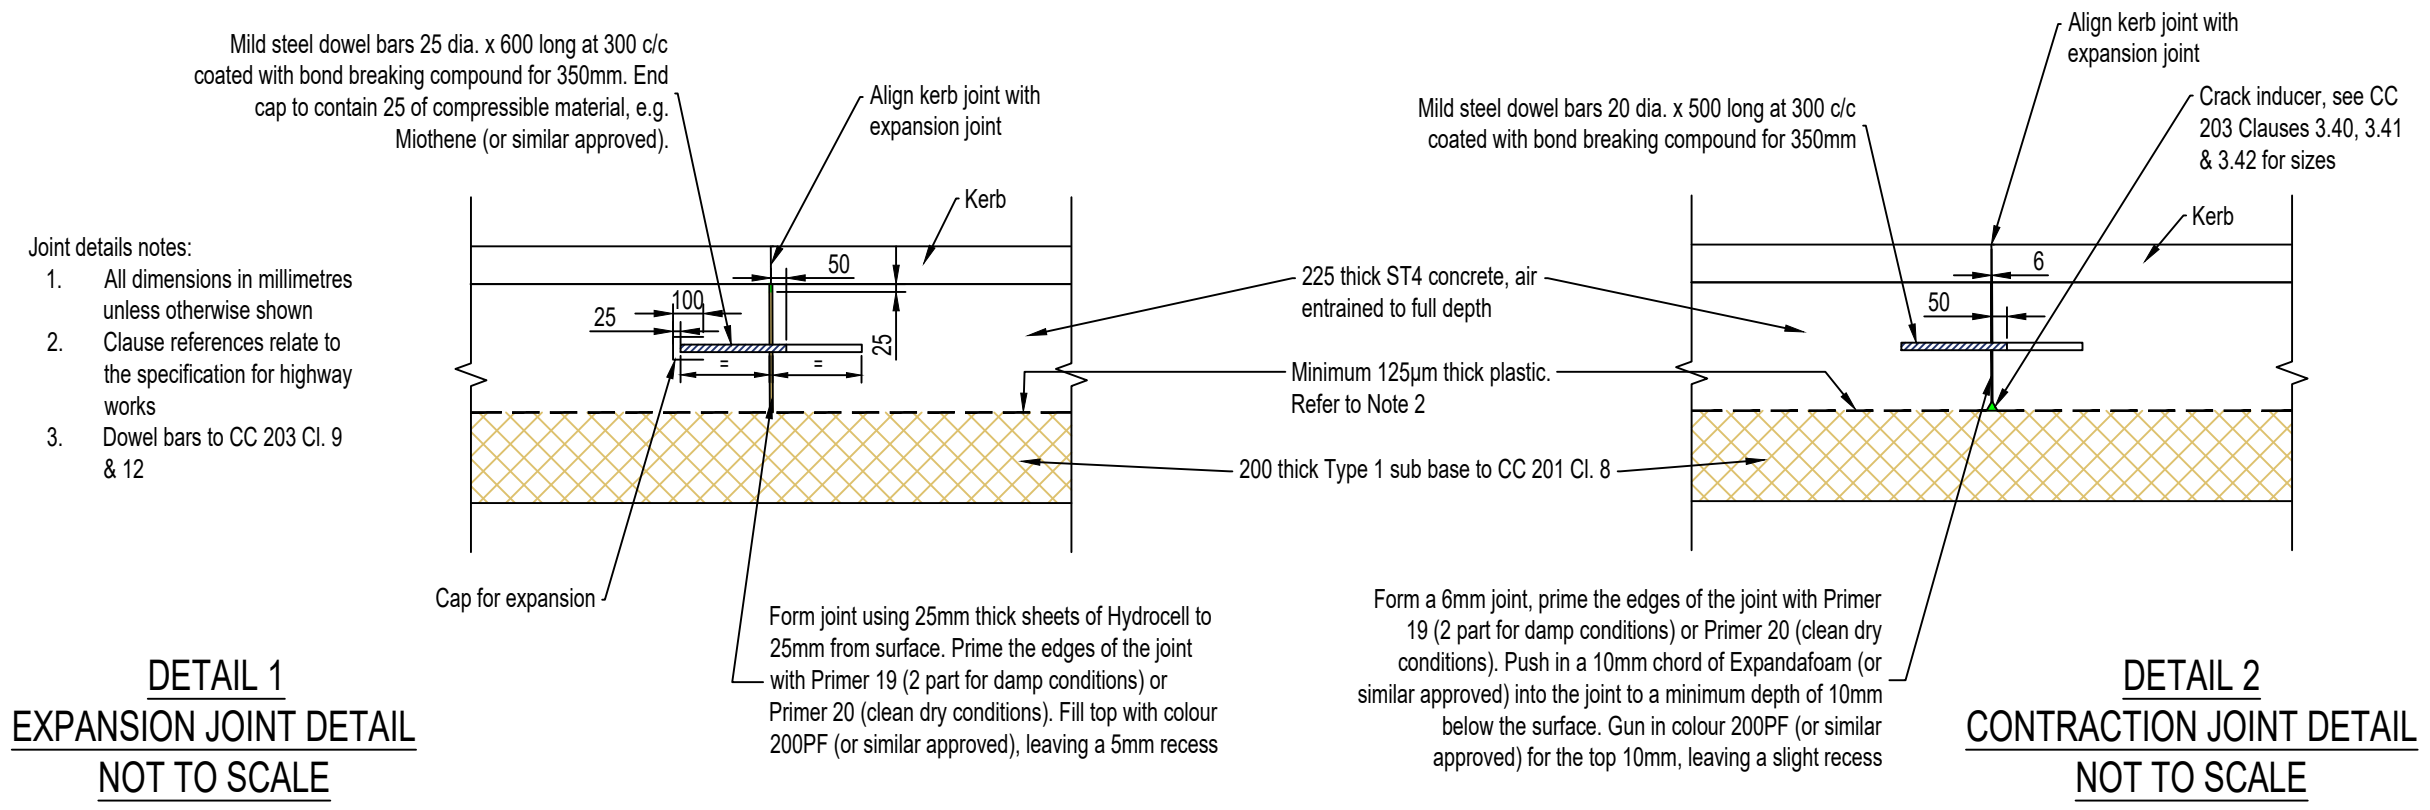